


LEATHER GREY


TOP DYEING - 3%



SPLIT - 3%

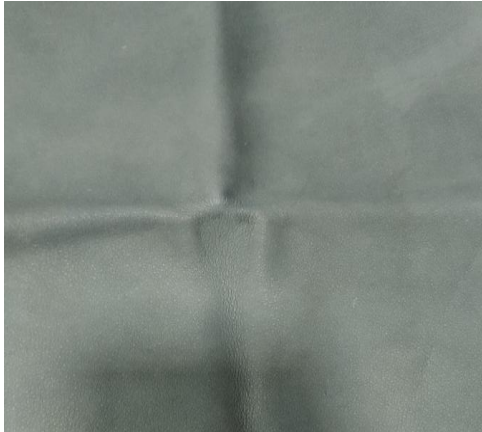

PENETRATION

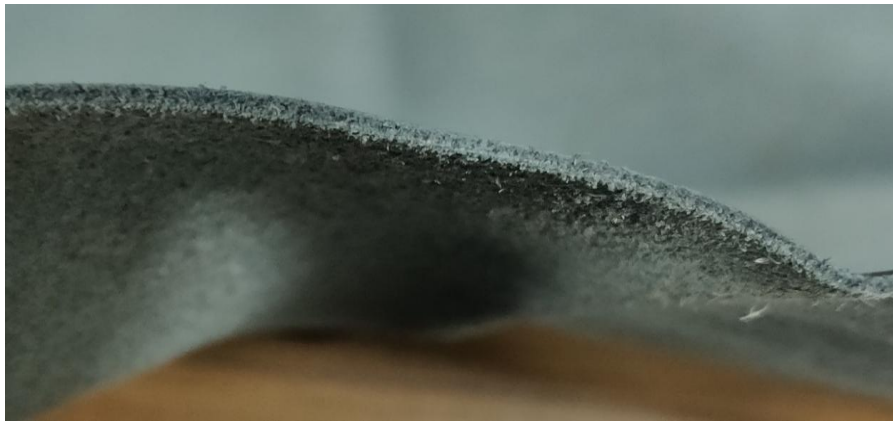

60° Solubility	Penetration	Light	F A S T N E S S					
			PERSPIRATION			WASHING		
			CS	SC	SW	CS	SC	SW
50	5	5	4-5	4	4	3	3	3

SCALE - 1 TO 5

CS - COTTON + SILK


SC - SPUN DIACETATE

SW - SPUN WOOL

Spectrum Peak Pick Report

08-07-2019 12:30:13 PM

Data Set: LEATHER GREY B-2018-131 10PPM - RawData

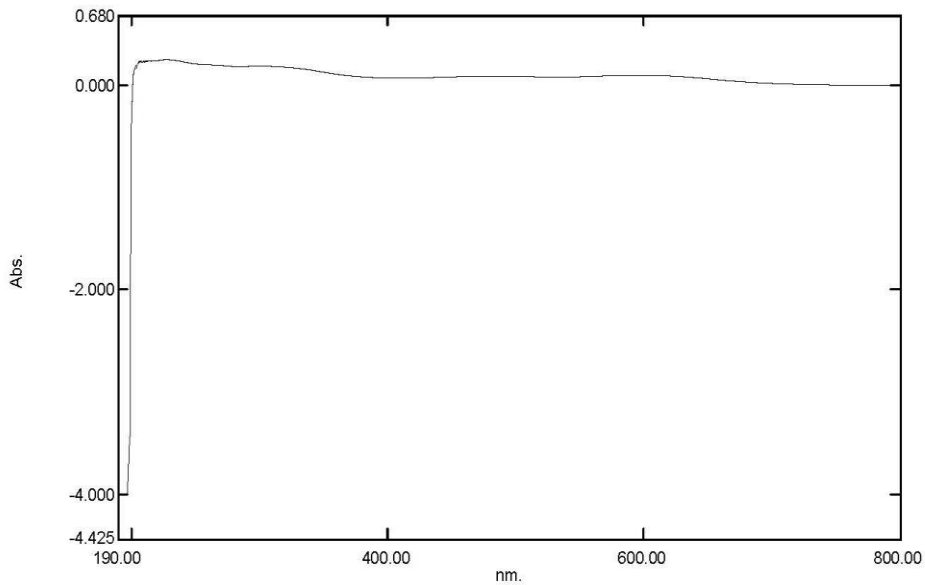

[Measurement Properties]
 Wavelength Range (nm.): 190.00 to 800.00
 Scan Speed: Fast
 Sampling Interval: 0.5
 Auto Sampling Interval: Enabled
 Scan Mode: Single

No.	P/V	Wavelength	Abs.	Description
1	●	597.50	0.099	
2	●	483.00	0.093	
3	●	301.00	0.191	
4	●	227.50	0.254	

[Instrument Properties]
 Instrument Type: UV-1900 Series
 Measuring Mode: Absorbance
 Slit Width: 1.0 nm
 Light Source Change Wavelength: 340.8 nm
 S/R Exchange: Normal

[Attachment Properties]
 Attachment: None


[Operation]
 Threshold: 0.0010000
 Points: 4
 InterPolate: Disabled
 Average: Disabled

[Sample Preparation Properties]
 Weight: 0.1
 Volume: 100
 Dilution: 10 PPM
 Path Length:
 Additional Information:

Spectrum Peak Pick Report

08-07-2019 12:32:02 PM

Data Set: LEATHER GREY B-2018-131 20PPM - RawData

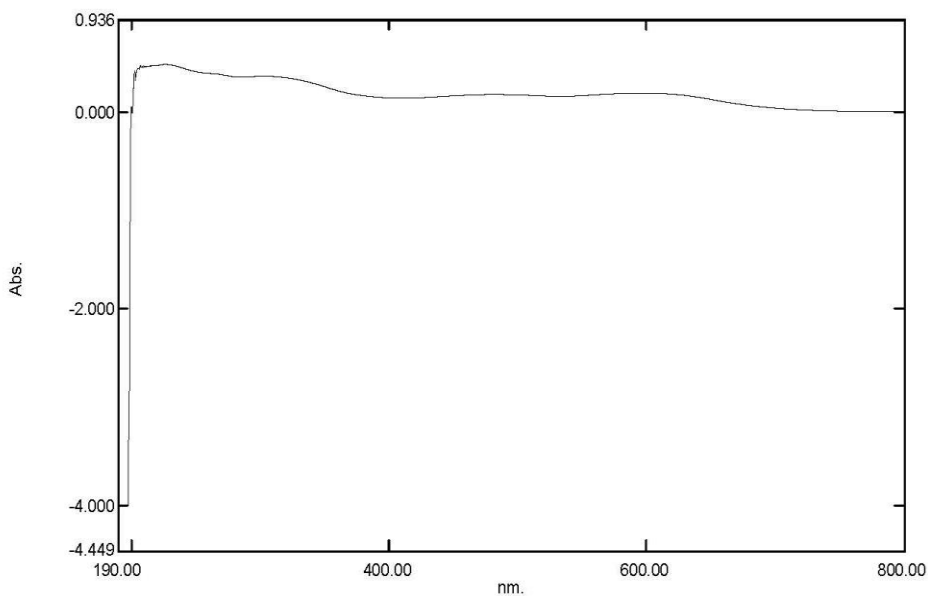

[Measurement Properties]
Wavelength Range (nm.): 190.00 to 800.00
Scan Speed: Fast
Sampling Interval: 0.5
Auto Sampling Interval: Enabled
Scan Mode: Single

No.	P/V	Wavelength	Abs.	Description
1	●	598.50	0.194	
2	●	482.50	0.181	
3	●	302.00	0.366	
4	●	225.50	0.487	

[Instrument Properties]
Instrument Type: UV-1900 Series
Measuring Mode: Absorbance
Slit Width: 1.0 nm
Light Source Change Wavelength: 340.8 nm
S/R Exchange: Normal

[Attachment Properties]
Attachment: None


[Operation]
Threshold: 0.0010000
Points: 4
InterPolate: Disabled
Average: Disabled

[Sample Preparation Properties]
Weight: 0.1
Volume: 100
Dilution: 20 PPM
Path Length:
Additional Information:

Spectrum Peak Pick Report

08-07-2019 12:32:32 PM

Data Set: LEATHER GREY B-2018-131 40PPM - RawData

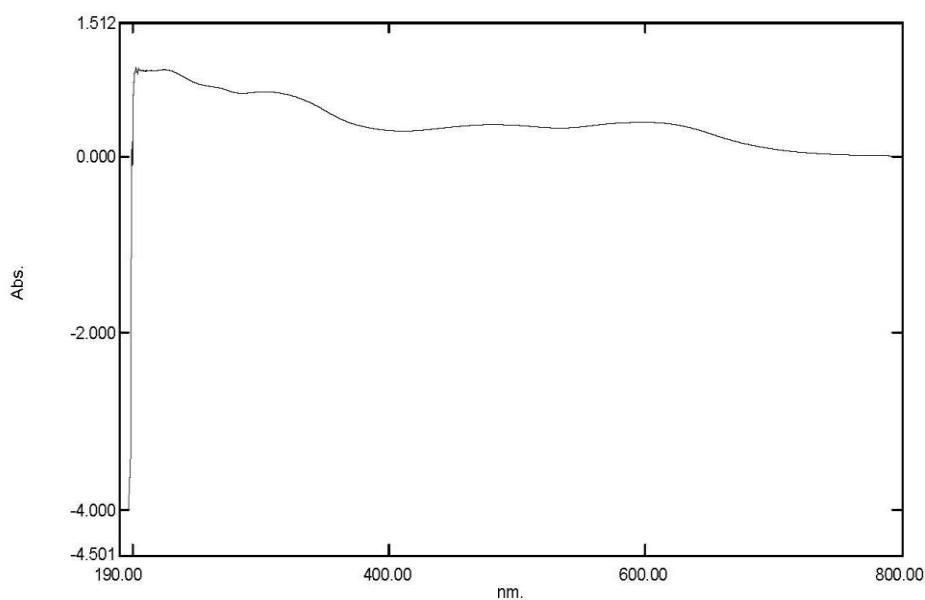

[Measurement Properties]
Wavelength Range (nm.): 190.00 to 800.00
Scan Speed: Fast
Sampling Interval: 0.5
Auto Sampling Interval: Enabled
Scan Mode: Single

No.	P/V	Wavelength	Abs.	Description
1	●	599.00	0.389	
2	●	482.00	0.362	
3	●	302.50	0.734	
4	●	225.00	0.985	

[Instrument Properties]
Instrument Type: UV-1900 Series
Measuring Mode: Absorbance
Slit Width: 1.0 nm
Light Source Change Wavelength: 340.8 nm
S/R Exchange: Normal

[Attachment Properties]
Attachment: None

[Operation]
Threshold: 0.0010000
Points: 4
InterPolate: Disabled
Average: Disabled

[Sample Preparation Properties]
Weight: 0.1
Volume: 100
Dilution: 40 PPM
Path Length:
Additional Information: